



Building 33, Scientia  
Room S166  
Meiring Naudé Road  
Pretoria

PO Box 36335  
Menlopark  
Pretoria, 0102  
South Africa



T0146

WCT (PTY) LTD T/A T.E.S.T. Africa  
reg #: 2000/024600/07  
vat reg #: 4620192684

Tel.: (+27 12) 349 114  
Fax.: (+27 12) 3491249  
E-mail: [info@testafrica.co.za](mailto:info@testafrica.co.za)  
Internet : <http://www.testafrica.co.za>



# Test Report

IEC 60669-2-2:2015

Particular requirements – Electromagnetic remote-control switches (RCD)  
Switches for household and similar fixed-electrical installations

REPORT # : WCT 21/1255

**CLIENT:**

*EasiWISE (Pty) Ltd  
Unit 13, Riversedge Business Park, Winelands Close  
Stikland, Bellville  
7530*

*Attention: Mr Carl Becker*

*Order #: Application Form  
Date of Order: 27 October 2021*

**SAMPLE:**

*Hybrid Geyser Controller*

**TEST SPECIFICATION:**

*IEC 60669-1:2017/ SANS 60669-1:2017  
IEC 60669-2-2:2006/ SANS 60669-2-2:2007*

**SUMMARY OF RESULTS:**

*Complied*

**DATE STARTED:**

*2021-10-27*

**DATE COMPLETED:**

*2022-02-17*


**DATE OF ISSUE:**

*2022-02-17*

**TESTED:**

  
\_\_\_\_\_  
GH Holtzhausen (Technical Signatory)

**APPROVED:**

  
\_\_\_\_\_  
AHJ de Winnaar (Test Engineer)

**NOTE:**

“ The South African National Accreditation System (SANAS) is a member of the International Laboratory Accreditation Cooperation (ILAC) Mutual Recognition Arrangement (MRA). This Arrangement allows for the mutual recognition of technical test and calibration data by the member accreditation bodies worldwide. For more information on the Arrangement please consult [www.ilac.org](http://www.ilac.org).”

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict

### **1. DESCRIPTION OF SAMPLE**

Manufacturer:	Semi-Logix
Model:	SLE03/ROOF/WiFi
Trade Name:	EasiWise
Country of Origin	Republic of South Africa
Rated Input:	Geyser Relay - 30 A/ Solar Relay - 5 A
Rated Voltage:	100 - 230 V AC 50 Hz

### **2. ABBREVIATIONS**

TEST DOES NOT APPLY:	N/A
SAMPLE MEET REQUIREMENTS (COMPLY):	C
SAMPLE DOES NOT MEET REQUIREMENTS (FAIL):	F
NOT TESTED:	N/T

### **3. SYMBOLS**

- Tests are not included in the SANAS Accreditation Schedule for our laboratory.
- ▲ Results from sub-contracted tests
- ◆ Opinions and interpretations expressed herein are outside the scope of SANAS accreditation

### **4. GENERAL REMARKS**

- \* Only a brief description of the requirements, measurements, etc. is given to indicate the nature of these. Consult the specification for details.
- \* The sections and subsections refer to in this report, are numbered as the test specification.
- \* This document shall not be reproduced in full unless approved by T.E.S.T. *Africa*.
- \* For sample identification, please see Appendix 1.

### **5. TEST CONDITIONS**

Climatic conditions that prevailed during tests:

	Maximum	Minimum	Limits
Ambient temperature	24 °C	20 °C	25 °C ± 10 °C
Relative humidity	54 %	35 %	Below 75 % RH

### **6. COMMENTS**

Complete unit submitted.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict

8	<b>MARKING</b>		C
8.1	Switches marked with:		C
	- rated current (A) or rated load (VA or W) .....		C
	- in amperes (A) if the switch is tested according to 19.1 only		C
	- in amperes (A) if the switch is tested according to 19.1 and 19.3 only or		N/A
	- in amperes (AX) if the switch is tested according to 19.1, 19.2 and 19.3 when the rated currents in amperes (A) and (AX) are equal or		N/A
	- in amperes (A and AX) if the switch is tested according to 19.1, 19.2 and 19.3 when the rated currents in amperes (A) and (AX) are not equal		N/A
	- rated voltage (V) .....	230	C
	- symbol for nature of supply .....	~	C
	- manufacturer's or responsible vendor's name, trade mark or identification mark .....	EasiWise	C
	- type reference .....	SLE03/ROOF/WiFi	C
	- symbol for mini-gap construction (m) .....		N/A
	- symbol for micro-gap construction ( $\mu$ ) .....		N/A
	- symbol for semiconductor switching device ( $\epsilon$ ).....		N/A
	- first IP characteristic numeral, if declared higher than 2, in which case the second characteristic numeral is also marked .....	Ordinary	N/A
	- second IP characteristic numeral, if declared higher than 0, in which case the first characteristic numeral is also marked .....	Ordinary	N/A
	- length of insulation to be removed before the insertion of the conductor into the screwless type terminal		N/A
	- symbol for suitability to accept rigid conductors only		N/A
	- for SBL loads: the rated power in watts and the type of load if the switch is tested according to 19.3		N/A
	- rated frequency (Hz) .....	50	C
	- rating and type of any fuse incorporated .....		N/A
	- symbol for kind of load (see 8.2)		C
	- the term "extension unit", if applicable, followed by the identifying reference .....		N/A
	- the minimum height for mounting the switch indicated in the installation instruction if there is a restriction (see 10.1) .....		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Switches with screwless terminals: marked with an indication of the suitability to accept rigid conductors only (if any) .....		N/A
	For electronic switches with included automatic function the number of operations stated in the accompanying instruction sheet when the manufacturer declares the number of operation is higher than indicated in subclause 19.101, 19.102 and 19.104 IEC 60699-2-1		N/A
	In addition		N/A
	For electronic RCS, subclause 8.1 of IEC 60669-2-2 applies IEC 60699-2-1		N/A
	For electronic TDS, subclause 8.1 of IEC 60669-2-3 applies IEC 60699-2-1		N/A
8.2	Symbols used: as required in the standard		C
	The symbol "AX" replaced by the symbol "X". For the marking with rated current and rated voltage the figures used alone		N/A
	Marking for the nature of supply placed next to the marking for rated current and rated voltage		C
8.3	Marking of electronic switch placed on the main part:		C
	- either the name, trade mark, or identification mark of the manufacturer or of the responsible vendor	EasiWise	C
	- length of insulation to be removed, if any		N/A
	- symbol for mini-gap construction, micro-gap construction or semiconductor switching device, if applicable		N/A
	- type reference	Symbol & Wording	C
	Information concerning more than one type of load not already marked on the electronic switch are stated in the accompanying instruction sheet		N/A
	Minimum and maximum current/load are stated for each type of load	30	C
	Information of the iron core transformer intended to be used with the electronic switch are given in the instruction sheet		N/A
	Cover plates necessary for safety purposes and intended to be sold separately: marked with the manufacturer's or responsible vendor's name, trade mark or identification mark and type reference		N/A
	IP code, when applicable, marked so as to be easily discernible when the switch is mounted and wired as in normal use	Ordinary	N/A
	Marking clearly visible and easily legible		C
	Markings not placed on parts removable without the use of a tool		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
8.4	Terminals for phase conductors (supply conductors): identified unless method of connection is of no importance, self evident or indicated on a wiring diagram	Single Phase	N/A
	Indications not placed on screws or other easily removable part		N/A
	Terminals associated with any one pole for switches of pattern number 2, 3, 03 and 6/2: similar identification differing from that of terminals associated with other poles		N/A
	Other terminals marked corresponding to the installation instructions		N/A
	Installation not made clear by the markings: a wiring diagram is provided with each electronic switch IEC 60669-2-2		N/A
	Terminals for control circuit marked according to IEC 60445 and with symbol according to 8.2 IEC 60699-2-2		N/A
	Terminals for control circuit of a priority RCS with current sensitive or voltage sensitive coil marked with symbol according to 8.2 IEC 60699-2-2		N/A
8.5	Neutral terminals: N.....:	Printed on PCB	C
	Earthing terminals: [earth symbol] .....	No Earthing	N/A
	Markings not placed on screws or other easily removable parts		C
	Terminals for conductors not forming part of the main function of the switch:		C
	- clearly identified unless their purpose is self evident, or		C
	- indicated in a wiring diagram fixed to the accessory		N/A
	Identification of equipment terminals may be achieved by:		N/A
	- their marking with graphical symbols according to IEC 60417 or colours and/or alphanumeric system, or		N/A
	- their physical dimension or relative location		N/A
8.6	Switches of pattern numbers 2, 3, 03 and switches with $V_n > 250$ V or $I_n > 16$ A are marked to indicate the switch position: direction of movement of the actuating member to its different positions or the actual switch position, clearly indicated .....		N/A
	Switches having more than one actuating member: marking indicates the effect achieved by the operation		N/A
	Marking clearly visible on the front of the switch		N/A
	Not possible to fix cover, cover plate, or removable actuating members in an incorrect position		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Symbols for “on” and “off” not used for indication of switch positions unless clearly indicate the direction of movement of the actuating members	Not in Design	N/A
8.7	Red colour only for push-button to open the circuit	Red not used	N/A
	If it is necessary to take special precautions when installing the switch, details of these given in an instruction sheet which accompanies the switch		N/A
	Instruction sheets written in the official language of the country in which the switch is to be sold		N/A
8.8	Special precautions necessary to take when installing the switch: details of these and clear information given in an instruction sheet which accompanies the switch	Instruction sheet	C
8.9	Marking durable and easily legible. Test: 15 s with water and 15 s with petroleum spirit	Still Legible	C

9	<b>CHECKING OF DIMENSIONS</b>		C
	Switches and boxes comply with the appropriate standard sheets, if any		C
	Electronic switches with dimensions other than those specified in the standard sheets (if any) if they are supplied with suitable boxes		N/A

10	<b>PROTECTION AGAINST ELECTRIC SHOCK</b>		C
10.1	Switches: live parts not accessible	Instruction sheet	C
	Switches designed to be fitted with pilot lights supplied at voltages other than ELV have means to prevent direct contact with the lamp		N/A
	Test with standard test finger shown in figure 1 of IEC 60529		C
	Switches with thermoplastic or elastomeric material: additional test carried out at 35 °C ± 2 °C with the test probe 11 of IEC 61032 (75 N for 1 min)	Thermoplastic	C
	Test probe applied to:		N/A
	- thin-walled knock-outs with a force of 10 N		N/A
	- viewing windows or the like on electronic switches intended to be mounted at a height > 1,7 m with a force of 30 N		N/A
	During the test: switches not deform and no live parts accessible		C
10.2	Knobs, operating levers, push buttons, rockers and the like: of insulating material, unless:		N/A
	- accessible metal parts separated from metal parts of mechanism by double or reinforced insulation, or		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.



IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	- reliably connected to earth		N/A
	The removal of protective impedance is only possible by destruction of the electronic switch or by rendering it unusable		N/A
	Test carried out between accessible metal parts and earth, through a non-inductive resistor of 2 kΩ:		N/A
	current measured: ≤ 0,7 mA (peak value), for a.c. up to 1 kHz .....		N/A
	current measured: ≤ 0,7 mA multiplied by the value of frequency in kHz, but not exceed 70 mA, for a.c. above 1 kHz .....		N/A
	current measured: ≤ 2 mA, for d.c. ....		N/A
10.3	Accessible parts of switches with $I_n \leq 16$ A: made of insulating material	Bigger current Rating	N/A
10.3.1	Accessible parts of switches when in normal use made of insulating material with the exception of the following:		N/A
	-small screws and the like which isolated from live parts and which used for the fixing of the base and of covers, cover plates and other parts of the enclosure		N/A
	-actuating members complying with 10.2		N/A
	-the covers, cover plates and other parts of the enclosure made of metal which comply with the requirements of 10.3.2 or 10.3.3		N/A
10.3.2	Metal covers or cover plates protected by supplementary insulation made by insulating linings or insulating barriers		N/A
	Insulating linings or insulating barriers:		N/A
	- cannot be removed without being permanently damaged		N/A
	or designed that:		N/A
	- cannot be replaced in an incorrect position;		N/A
	- if they are omitted, accessories are rendered inoperable or manifestly incomplete		N/A
	- there is no risk of accidental contact between live parts and metal covers or cover plates;		N/A
	- precautions are taken to prevent creepage distances or clearances becoming less than the values specified in clause 23		N/A
10.3.3	Earthing of metal covers or cover plates: connection of low resistance	No Earthing	N/A
10.4	Metal parts of mechanism not insulated from live parts: not protrude from enclosure	All Insulated	N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Switches operated by means of a removable key or similar device: metal parts of mechanism insulated from live parts		N/A
10.5	Metal parts of mechanism not accessible and insulated from accessible metal parts, unless		N/A
	- separated from live parts (creepage distances and clearances have at least twice the value specified in clause 23), or		N/A
	- reliably connected to earth		N/A
	For unenclosed stack-type switches having a metal spindle pivoting in a metal base plate, the additional requirement means that the creepage distances and clearances between live parts and the spindle, and between metal parts of the mechanism and base plate, at least twice the value specified in Clause 23		N/A
10.6	Switches operated by means of a removable key or an intermediate part: key or an intermediate part can only touch parts insulated from live parts		N/A
	key or intermediate part: insulated from metal parts of mechanism, unless		N/A
	creepage distances and clearances between live parts and metal parts of mechanism have at least twice the values specified in clause 23		N/A
10.7	Cord-operated switches: impossible to touch live parts when fitting or replacing the pull cord		N/A

11	<b>PROVISION FOR EARTHING</b>		N/A
	Clause not applicable to SELV electronic switches	No provision for Earthing	N/A
11.1	Accessible metal parts: provided with, or permanently and reliably connected to, an earthing terminal		N/A
11.2	Earthing terminals: with screw clamping or screwless terminals and comply with clause 12		N/A
	Capacity of earthing terminals of the same size as the corresponding terminals for the supply conductors		N/A
	Any additional external earthing terminal has a size suitable for conductors of at least 6 mm <sup>2</sup> (mm <sup>2</sup> ) .....		N/A
11.3	Surface-type switches with an enclosure of insulating material, with IP > X0 and more than one cable inlet, are provided for the continuity of the earthing circuit with:		N/A
	- an internal fixed earthing terminal, or		N/A
	- adequate space for a floating terminal allowing the connection of an incoming and outgoing conductor		N/A
11.4	Connection between earthing terminal and accessible metal parts: of low resistance		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.



IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Test current equal to 1,5 In or 25 A (A) .....		-
	Resistance $\leq 0,05 \Omega$ ( $\Omega$ ) .....		N/A
11.101	Printer conductors of printed boards providing protective earthing continuity under following conditions		N/A
	- at least two tracks used each having independent soldering point withstanding a single short circuit test		N/A
	- single track used with two independent means of connection on each end withstanding a single short circuit test		N/A
	In addition		-
	- material of printed circuit board consist of epoxide woven glass copperclad laminated sheet and		N/A
	- comply with the overload test according to 101.1.1.2		N/A

12	<b>TERMINALS</b>		C
12.1	General		C
	Switches provided with screw-type terminals or with screwless terminals .....	Terminals	C
	Clamping means of terminals: not serve to fix any other components		C
	All the test on terminals, with the exception of the test of 12.3 11, made after the test of 15.1		C
12.2.1	Terminals with screw clamping for external copper conductors		N/A
	Switches provided with terminals which allows the proper connection of copper conductors as shows in table 2	Screwless	N/A
	Rated current (A) .....		
	Type of conductor (rigid / flexible) .....		
	Smallest / largest cross-sectional area (mm <sup>2</sup> ) .....		
	Diameter of largest conductor (mm) .....		
	Figure of terminal .....		
	Minimum diameter D (minimum dimensions) of conductor space: required (mm); measured (mm) ...:		N/A
12.2.2	Terminals allow the conductor to be connected without special preparation		N/A
12.2.3	Terminals have adequate mechanical strength		N/A
	Screws and nut for clamping the conductors have metric ISO thread or a comparable thread		N/A
	Screws not of soft metal such as zinc or aluminium		N/A
12.2.4	Terminals resistant to corrosion		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Terminals, the body of which is made of copper or copper alloy as specified in 22.5 considered as complying with this requirement		N/A
12.2.5	Screw-type terminals clamp the conductor(s) without undue damage	See appended table 12.2.5	N/A
	During the test: conductor not slip out, no break near clamping unit and no damage		N/A
12.2.6	Terminals clamp the conductor reliably between metal surfaces	See appended table 12.2.6	N/A
	During the test: conductor not move noticeably		N/A
12.2.7	Terminals designed or placed that the conductor cannot slip out while the clamping screws or nuts are tightened	See appended table 12.2.7	N/A
	After the test: no wire of the conductor escaped outside the clamping unit thus reducing creepage distances and clearances to values lower than those indicated in clause 23		N/A
12.2.8	Terminals with screw clamping so fixed or located within the switch that, when the clamping screws or nuts are tightened or loosened, the terminals not work loose from their fixing to the switch		N/A
	Movement of the terminal allowed so long as it is sufficiently limited so as to prevent non-compliance with this document		N/A
	The use of sealing compound or resin considered to be sufficient for preventing a terminal from working loose provided that		N/A
	- the sealing compound or resin not subject to stress during normal use, and		N/A
	- the effectiveness of the sealing compound or resin not impaired by temperatures attained by the terminal under the most unfavourable conditions specified in this document		N/A
	Torque test:		N/A
	- rated current (A) .....		
	- solid rigid copper conductor of the largest cross-sectional area (mm <sup>2</sup> ) (table 4) .....		
	- torque (Nm) (table 5 or appropriate figures 1, 2, 3, 4) .....		
	Screws and nuts tightened and loosened 5 times. During the test: terminals not work loose and show no damage		N/A
12.2.9	Clamping screws or nuts of earthing terminals: adequately locked against accidental loosening, not possible to loosen them without the aid of a tool	No Earthing	N/A
12.2.10	Earthing terminals: no risk of corrosion		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Body of brass or other metal no less resistant to corrosion		N/A
	If the body is a part of a frame or enclosure of aluminium alloy, precautions are taken to avoid the risk of corrosion		N/A
12.2.11	Pillar terminals: distance g no less than the value specified in figure 1: required (mm); measured (mm) .....:		N/A
	Mantle terminals: distance g no less than the value specified in figure 5: required (mm); measured (mm) .....:		N/A
12.2.12	Lug terminals:		N/A
	- used only for switches having rated current $\geq 40$ A		N/A
	- fitted with spring washers or equally effective locking means		N/A
12.3	Screwless terminals for external copper conductors		C
12.3.1	Screwless terminals of the type suitable for:		C
	- for rigid copper conductors only, or		N/A
	- for both rigid and flexible copper conductors (tests carried out with rigid and then repeated with flexible conductors)		C
	12.3 in not applicable to switches provided with		N/A
	- screwless terminals requiring the fixing of special devices to the conductors before clamping in the screwless terminal, for example flat push-on connectors		N/A
	- screwless terminals requiring twisting of the conductors, for example those with twisted joints		N/A
	- screwless terminals providing direct contact to the conductors by means of edges or points penetrating the insulation		N/A
12.3.2	Screwless terminals provided with clamping units which allow the proper connection of rigid or of rigid and flexible conductors having nominal cross-sectional areas as shown in table 4		C
	Rated current (A) .....	30	
	Type of conductor (rigid / flexible) .....	Rigid/ Flexible	
	Smallest / largest cross-sectional area (mm <sup>2</sup> ) .....	4,0 to 10,0	
	Diameter of largest rigid conductor (mm) .....	4,34	
	Diameter of largest flexible conductor (mm) .....	4,34	
12.3.3	Screwless terminals allow the conductor to be connected without special preparation		C
12.3.4	Parts of screwless terminals intended for carrying current of materials as specified in 22.5		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
12.3.5	Screwless terminals clamp specified conductors with sufficient contact pressure without undue damage to the conductor		C
	Conductor clamped between metal surfaces		C
12.3.6	It is clear how the connection and disconnection of the conductors is to be made		C
	Disconnection of a conductor require an operation, other than a pull, so that can be made manually with or without a general-purpose tool		C
	It is not possible to confuse the opening for the use of a tool with the opening intended for the conductor		C
12.3.7	Screwless terminals intended for the interconnection of two or more conductors:		N/A
	- during insertion, operation of clamping means of one of the conductors is independent of operation of that for the other conductor(s);		N/A
	- during disconnection, conductors can be disconnected either at the same time or separately;		N/A
	- each conductor introduced in a separate clamping unit.		N/A
	It is possible clamp securely any number of conductors up to the maximum as designed. Number of conductors; Nominal cross-sectional area (mm <sup>2</sup> ) .....		N/A
12.3.8	Screwless terminals: adequate insertion obvious and over-insertion prevented		C
	Screwless terminals of switches: undue insertion of the conductor prevented by a stop if further insertion is liable to reduce creepage distances and/or clearances required in table 20 or to influence the mechanism		C
12.3.9	Screwless terminals properly fixed to the switch		C
	Not work loose when conductors are connected or disconnected		C
	Self-hardening resins used to fix terminals not subject to mechanical stress		N/A
12.3.10	Screwless terminals withstand mechanical stresses occurring in normal use	See appended table 12.3.10	C
	During application of the pull conductor not come out of the terminal		C
	Test with apparatus shown in figure 10	See appended table 12.3.10	C
	During the test conductors not move noticeably in the clamping unit		C
	After these tests: neither terminals nor clamping means have worked loose and conductors show no deterioration		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
12.3.11	Screwless terminals withstand electrical and thermal stresses occurring in normal use	See appended table 12.3.11	C
	After the test: inspection show no changes		C
	Repetition of test according to 12.3.10: screwless terminals withstand mechanical stresses occurring in normal use	See appended table 12.3.11	C
	During application of the pull conductor not come out of the terminal		C
	Test with apparatus shown in figure 10	See appended table 12.3.11	C
	During the test conductors not move noticeably in the clamping unit		C
	After these tests: neither terminals nor clamping means have worked loose and conductors show no deterioration		C
12.3.12	Screwless terminals: connected rigid solid conductor remains clamped, even when deflected during normal installation	See appended table 12.3.12	C

13	<b>CONSTRUCTIONAL REQUIREMENTS</b>		C
13.1	Insulating lining, barriers and like: adequate mechanical strength and secured in a reliable manner		C
13.2	Switches constructed so as to permit:		C
	- easy introduction and connection of the conductors in the terminals;		C
	- correct positioning of the conductors		C
	- easy fixing of the switch to a wall or in a box	Separate Box	C
	- adequate space between underside of the base and the surface on which the base is mounted or between the sides of the base and the enclosure (cover or box)		C
	Surface-type switches: fixing means do not damage insulation of the cable		N/A
	Switches classified as design A: permit easy positioning and removal of the cover or cover plate, without displacing the conductors		C
13.3	Covers, cover-plates and actuating members or parts of them intended to ensure protection against electric shock:		C
	- held in place at two or more points by effective fixings	3 Screws	C
	- fixed by means of a single fixing, for example by a screw, provided that they are located by another means (for example by a shoulder)		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Fixings of covers, cover-plates or actuating members of switches of design A serves to fix the base: there is means to maintain the base in position, even after removal of the covers, cover-plates or actuating members		N/A
13.3.1	Covers, cover plates or actuating members whose fixing is of the screw-type:		C
	Compliance checked by inspection only		C
13.3.2	Covers, cover plates or actuating members whose fixing is not dependent on screws and whose removal is obtained by applying a force in a direction approximately perpendicular to the mounting/supporting surface:		N/A
	Compliance checked, when their removal may give access, with the standard test finger:		N/A
	to live parts: by the test of 20.4 (verification of the non-removal and the removal)		N/A
	to non-earthed metal parts separated from live parts by creepage distances and clearances according to table 20: by the test of 20.5 (verification of the non-removal and the removal)		N/A
	only to insulating parts, or earthed metal parts, or metal parts separated from live parts by creepage distances and clearances twice those according to table 20, or live parts of SELV circuits not greater than 25 V a.c.: by the test of 20.6 (verification of the non-removal and the removal)		N/A
13.3.3	Covers, cover-plates or actuating members whose fixing is not dependent on screws and whose removal is obtained by using a tool, in accordance with the manufacturer's information given in an instruction sheet or in a catalogue:		N/A
	Compliance checked, when their removal may give access, with the standard test finger:		N/A
	to live parts: by the test of 20.4 (verification of the non-removal only)		N/A
	to non-earthed metal parts separated from live parts by creepage distances and clearances according to table 20: by the test of 20.5 (verification of the non-removal only)		N/A
	only to insulating parts, or earthed metal parts, or metal parts separated from live parts by creepage distances and clearances twice those according to table 20, or live parts of SELV circuits not greater than 25 V a.c.: by the test of 20.6 (verification of the non-removal only)		N/A
13.4	Switches: no free openings in their enclosures according to their IP classification		C
13.5	Knobs of electronic switches are securely fixed in a reliable manner	No Knobs	N/A
	knobs used to indicate the position of switches: not possible to fix them in a wrong position, if this may result in a hazard		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.



IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Pull and push tests:		N/A
	- axial pull is likely to be applied: 30 N for 1 min		N/A
	- axial pull is unlikely to be applied: 15 N for 1 min		N/A
	- axial push: 30 N for 1 min		N/A
	During and after these tests:		N/A
	- the electronic switch shows no damage		N/A
	- an actuating member have not moved so as to impair compliance with this standard		N/A
13.6	Screws or other means for mounting the switch on a surface or in a box or enclosure: easily accessible from the front.		C
	Fixing means not serve any other fixing purpose		C
13.7	Combinations of switches, or of switches and socket-outlets, comprising separate bases: correct position of each base ensured		N/A
	Fixing of each base independent of the fixing of the combination to the mounting surface		N/A
13.8	Accessories combined with switches: comply with their standard		C
13.9	Surface-type switches with IP > 20 are in according to their classification when fitted with conduits or with sheathed cables		N/A
	Surface-type switches with IPX4 or IPX5 have provisions for opening a drain hole		N/A
	Switches provided with a drain hole: it is not less than 5 mm in diameter, or 20 mm <sup>2</sup> in area with a width and a length not less than 3 mm .....: Ø mm / mm <sup>2</sup>		N/A
	Drain hole: effective		N/A
	Lid springs (if any): of corrosion resistant material (bronze or stainless steel)		N/A
13.10	Switches to be installed in a box: conductor ends can be prepared after the box is mounted in position, but before the switch is fitted in the box		C
	Base have adequate stability when mounted in the box		C
13.11	Surface-type switches with IP > X0, pattern numbers 1, 5 and 6, with more than one inlet opening, provided with:		N/A
	- fixed additional terminal complying with the requirements of clause 12, or		N/A
	- adequate space for a floating terminal		N/A
13.12	Inlet openings: allow the introduction of the conduit or the sheath of the cable		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Surface-type switches: intended conduit or protective covering can enter at least 1 mm into the enclosure		N/A
	Inlet openings for conduit entries of surface-type switches: capable of accepting conduit sizes of 16, 20, 25 or 32 or a combination of at least two of these sizes not excluding two of the same size .....		N/A
	Inlet openings for cable entries of surface-type switches: capable of accepting cables having the dimensions specified in table 12 or be as specified by the manufacturer: rated current (A); limits of external diameter of cables min/max (mm) .....		N/A
13.13	Surface-type switches: provision for back entry (if are intended)		N/A
13.14	Membranes or the like (if provided): replaceable		N/A
13.15	Requirements for membranes in inlet openings		N/A
13.15.1	Membranes, lenses and the like reliably fixed and not displaced by the mechanical and thermal stresses occurring in normal use		N/A
	Test on electronic switches fitted with membranes, lenses and the like subjected to the ageing treatment specified in 15.1:		N/A
	Electronic switches placed at $40\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ for 2 h; force of 30 N applied for 5 s by means of the tip of test probe 11 of IEC 61032. During these tests: membranes, lenses and the like are not deformed, live parts not accessible		N/A
	Membranes, lenses and the like likely to be subjected to an axial pull: axial pull of 30 N applied for 5 s. During this test: membranes, lenses and the like not come out		N/A
	Test repeated on membranes, lenses and the like not subjected to any treatment		N/A
13.15.2	Membranes in inlet openings: introduction of the cables into the accessory permitted when the ambient temperature is low		N/A
	Test on membranes not subjected to the ageing treatment specified in 15.1 and fitted with the switches		N/A
	Switches kept at $-5\text{ }^{\circ}\text{C}$ for 2 h: possibility to introduce cables of the heaviest type through the membranes		N/A
	After the test: no harmful deformation, cracks or similar damage		N/A
13.16		Fixed Installation	N/A
13.101	Transformers intended for SELV circuits of safety isolating type and comply with IEC 61558-2-6		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
14	<b>MECHANISM</b>		C
14.1	Actuating member of a switch, when released, automatically take up the position corresponding to that of moving contacts		C
14.2	Moving contact of switches can come to rest only in "on" and "off" positions		C
	Intermediate position permissible if:		N/A
	- it corresponds to the intermediate position of the actuating member, and		N/A
	- the insulation between fixed and moving contacts is adequate. Electric strength test as specified in 16.2: test voltage a.c. for 1 min (V) .....: 500 V / 750 V / 1250 V / 2000 V		N/A
14.3	No undue arcing in slowly operation		N/A
	Test carried out at the end of the test of clause 19.1: breaking of the circuit 10 times, actuating member moved over a period of 2 s. During the test: no sustained arcing		N/A
14.4	Switches of pattern numbers 2, 3, 03 and 6/2 make and break all poles substantially simultaneously		N/A
	Neutral pole of switches of pattern numbers 03 not make after or break before the other poles		N/A
14.5	Action of the mechanism: independent of the presence of cover or cover plate. Test: no flicker		N/A
14.6	Cord-operated switches: effecting a change by application and removal a pull not exceeding:		N/A
	- 45 N applied vertically, and		N/A
	- 65 N applied at $45^\circ \pm 5^\circ$		N/A
14.101	Position for hand-operated device indicated clearly and without ambiguity		N/A

15	<b>RESISTANCE TO AGEING, PROTECTION PROVIDED BY ENCLOSURES OF SWITCHES, AND RESISTANCE TO HUMIDITY</b>		C
15.1	Resistance to ageing		C
	Switches and boxes placed for 7 days (168 h) in a heating cabinet at $70^\circ\text{C} \pm 2^\circ\text{C}$		C
	- no crack visible after test with normal or corrected vision without additional magnification		C
	- no sticky or greasy material as a result of heat		C
	- no trace of cloth (forefinger pressed with 5 N)		C
	- no other damage as a result of heat		C
15.2	Protection provided by enclosures of switches		C
15.2.1	Protection against access to hazardous parts and against harmful effects due to ingress of solid foreign objects		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Enclosure of the switch provides a degree of protection against access to hazardous parts and against harmful effects due to ingress of solid foreign objects in accordance with the IP classification of the switch		C
	Glands: torque (Nm) (2/3 of torque applied in 20.3) :		
	Screws of the enclosure: torque (Nm) (2/3 table 3) .....: 0,8		
15.2.1.1	Protection against access to hazardous parts		C
	Appropriate test according to IEC 60529 .....:		C
15.2.1.2	Protection against harmful effects due to ingress of solid foreign objects		C
	Appropriate test according to IEC 60529 .....:		N/A
	Dust not penetrate in quantity to interfere with satisfactory operation or to impair safety		N/A
15.2.2	Protection against harmful effects due to ingress of water		N/A
	Enclosure of switches provide a degree of protection against harmful effects due to ingress of water in accordance with their IP classification		N/A
	Appropriate test according to IEC 60529 .....:		N/A
	Flush-type and semi-flush-type switches fixed:		N/A
	- in a test wall using an appropriate box in accordance with the manufacturer's instructions		N/A
	- in a test wall according to figure 27		N/A
	Screws of the enclosure: torque (Nm) (2/3 table 3) .....:		
	Glands: torque (Nm) (2/3 of torque applied in table 19) .....:		
	Specimens withstand an electric strength test specified in 16.2 which is started within 5 min of completion of the test		N/A
15.2.3	Protection against harmful effects due to ingress of water		N/A
15.3	Resistance to humidity		C
	Switches proof against humidity which may occur in normal use		C
	Compliance checked by a humidity treatment carried out in a humidity cabinet containing air with relative humidity maintained between 91 % and 95 %. Specimens kept in the cabinet for:		C
	- 2 days (48 h) for switches with IPX0		C
	- 7 days (168 h) for switches with IP>X0		N/A
	After this treatment: specimens show no damage		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
16	<b>INSULATION RESISTANCE AND ELECTRIC STRENGTH</b>		C
16.1	The insulation resistance and electrical strength of switches adequate		C
16.2	The insulation resistance measured 1 min after application of 500 V d.c.	See appended table 16.1	C
16.3	Electric strength: a.c. test voltage applied for 1 min	See appended table 16.2	C

17	<b>TEMPERATURE RISE</b>		C
17.1	Switches so constructed that the temperature rise in normal use is not excessive		C
	No oxidation or any other deterioration of contacts, if any		C
	To ensure normal cooling of the terminal, the conductors connected to them have a length of at least 1 m		C
	During the test:		C
	- electronic switch state not change		C
	- fuses and other protective devices not operate		N/A
	- permissible temperature rises determined in table 102, column concerning clause 17, not exceeded	See appended table 17	C
	After the test, electronic switch is in operating condition		C
	Sealing compounds, if any, have not flowed		N/A
	For RCS energized by impulses, test is conducted without connecting the coil IEC 60669-2-2		N/A
	For permanently energized RCS, the coil is connected to 1,06 rated voltage IEC 60669-2-2		N/A

18	<b>MAKING AND BREAKING CAPACITY</b>		C
18.1	Electronic switches have adequate making and breaking capacity		C
	Test carried out only on electronic switches provided with mechanically or electromechanically operated contact mechanisms		C
	Contact mechanisms have adequate making and breaking capacity		C
	Test made on three new specimens of the complete contact mechanism		C
	Model/type reference .....	SLE03/ROOF/WiFi	
	Pattern number .....	1	
	Rated current (A) / Rated load (W or VA) .....	30 A	

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Rated voltage (V) .....	~ 230 VAC	
	Test for electronics switches for the control of:		C
	- fluorescent lamp loads, as specified in 18.1 of part 1;		N/A
	- motor speed control circuits, as specified in 18.1 of part 1 and, additionally, in 18.101;		N/A
	- voltage of iron core transformers for extra low-voltage incandescent lamps, as specified in 18.1, 18.2 of part 1 and, additionally, in 18.102;		N/A
	- voltage of electronic step-down converters for extra low-voltage incandescent lamps, as specified in 18.2 of part 1;		N/A
	- other types of load, as specified in 18.1 and 18.2 of part 1.		C
	Rate of operation (operation per minute) .....	6	—
	Electronic switches whose cycle of operation limited by their application: rate of operation specified by the manufacturer (operation per minute) .....	6	—
	Electronic switches fitted with conductors having nominal cross-sectional area as for the test of clause 17 (mm <sup>2</sup> ) .....	4,0	—
18.2	Overload		C
	- test voltage (1,1 V <sub>n</sub> ) (V) .....		—
	- test current (1,25 I <sub>n</sub> ) (cos φ 0,3) (A) .....		—
	- 200 operations; rate (operations per minute) .....		—
	- electronic switches whose rate of operation is limited by their application (for example, heat and light sensors): electronic switch is set to the shortest cycle time possible and re-activated at the end of each cycle within a time of (2 ± 0,5) s .....		—
	- samples number .....	1	—
	During the test: no sustained arcing		N/A
	After the test: specimens show no damage		N/A
18.3	Overload test with filament lamps		N/A
	- test voltage (V <sub>n</sub> ) (V) .....		—
	- test current (≥ 1,2 I <sub>n</sub> ) (A) .....		—
	- number of 200 W tungsten filament lamps .....		—
	- 200 operations; rate (operations per minute) .....		—
	- samples number .....		—
	During the test: no sustained arcing nor welding of the contacts		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.



IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	After the test: specimens show no damage		N/A

19	<b>NORMAL OPERATION</b>		C
19.1	Electronic switches withstand the mechanical, electrical and thermal stresses occurring in normal use		C
	For RCS equipped with incorporated hand-operated device, acting directly on the switching circuit, 10 % of operation indicated in Table 16 made by hand or equivalent manner for those of a.c. operation, followed by test of 14.3 IEC 60669-2-2		N/A
	Electronic switches whose cycle of operation is limited by their application: rate of operation specified by the manufacturer (operation per minute) .....		—
19.2	Switches intended for externally ballasted lamp loads withstand, the electrical and thermal stresses occurring when controlling externally ballasted lamp circuits		—
19.3	Switches intended for self ballasted lamp (SBL) load withstand the electrical and thermal stresses occurring when controlling self ballasted lamp circuits	Considered	—
19.101	An RCS energized by impulses operate at a control voltage 0,9 to 1,1 times rated value with an impulse duration as declare by Manufacturer IEC 60669-2-2		N/A
19.102	Permanently energized RCS operate as intended at any value between 0,85 to 1,1 times rated control IEC 60669-2-2		C

20	<b>MECHANICAL STRENGTH</b>		C
20.1	The test of the relevant subclauses 20.5 to 20.9 applied according to the type construction as specified in 13.3		C
	Accessories, surface mounting boxes, screwed glands and shrouds have adequate mechanical strength so as to withstand the stresses imposed during installation and use		C
20.2	For all types of switches and for boxes: impact test (9 blows)	See appended table 20.1	C
	After the test: no damage, live parts no become accessible		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
20.3	Bases of surface-type switches first fixed to a cylinder of rigid steel sheet of radius equal to 4,5 times the distance between fixing holes (mm) .....		N/A
	Bases then fixed to a flat steel sheet		N/A
	Torque applied to fixing screws (Nm) .....	0,5 Nm / 1,2 Nm	
	During and after the test: bases show no damage		N/A
20.4	Screwed glands of switches other than ordinary: torque test		N/A
	- diameter of cylindrical metal test rod (mm) .....		
	- type of material .....	metal / moulded material	
	- torque for 1 min (table 19) (Nm) .....		
	After the test: no damage of glands and enclosure of the specimens		N/A
20.5.1	Force necessary for covers, cover-plates or actuating members to come off or not to come off (accessibility with the test finger to live parts)		C
20.5.2	Verification of the non-removal of covers, cover-plates or actuating member		C
	Force applied for 1 min in direction perpendicular to the mounting surface .....	40 N / 80 N	
	Covers, cover-plates or actuating members not come off		C
	Test repeated on new specimens with a sheet of hard material, 1 mm ± 0,1 mm thick, fitted around the supporting frame (fig. 19)		N/A
	Covers, cover-plates or actuating members not come off		N/A
	After the test: no damage		N/A
20.5.3	Verification of the removal of covers, cover-plates or actuating members		C
	Force not exceeding 120 N applied 10 times in direction perpendicular to the mounting / supporting surface: covers, cover-plates or actuating members come off		C
	Test repeated on new specimens with a sheet of hard material, 1 mm ± 0,1 mm thick, fitted around the supporting frame (fig. 19)		N/A
	Covers, cover-plates or actuating members come off		N/A
	After the test: no damage		N/A
20.6	Force necessary for covers, cover-plates or actuating members to come off or not to come off (accessibility to insulating parts, earthed metal parts, live parts of SELV ≤ 25 V a.c. or metal parts separated from live parts by creepage distances twice those according to table 20)		C
20.7	Force necessary for covers, cover-plates or actuating members to come off or not to come off (accessibility with the test finger to non-earthed metal parts separated from live parts by creepage distances and clearances according to table 20)		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
20.8	Test with gauge of figure 20 applied according to figure 21 for verification of the outline of covers, cover-plates or actuating members: distances between face C of gauge and outline of side under test, not decrease .....	<u>complying</u> / not complying	
20.9	Test with gauge according to figure 23 applied as shown in figure 24 (1 N): gauge not enter more than 1mm .....	<u>complying</u> / not complying	
20.10	Operating members of cord-operated switch have adequate strength		N/A
	Pull test: pull 100 N for 1 min (normal use); pull of 50 N for 1 min (unfavourable direction). After the test:		N/A
	- switch show no damage		N/A
	- operating member not broken and cord-operated switch still operate		N/A

21	<b>RESISTANCE TO HEAT</b>		C
21.1	Switches kept for 1 h in a heating cabinet at a temperature of 100 °C ± 2 °C		C
	During the test: no change impairing their further use and sealing compound, if any, not flow		C
	After the test: no access to live parts, markings still legible		C
21.2	Parts of insulating material necessary to retain current-carrying parts and parts of the earthing circuit in position: ball-pressure test (1 h, 125 °C)	See appended table 21.2	C
21.3	Parts of insulating material not necessary to retain current-carrying parts and parts of the earthing circuit in position, even though in contact with them: ball-pressure test (1 h)	See appended table 21.3	N/A

22	<b>SCREWS, CURRENT-CARRYING PARTS AND CONNECTIONS</b>		C
22.1	Connections withstand mechanical stresses		C
	Thread-forming or thread-cutting screws used only if supplied together with the piece in which they are intended to be inserted		N/A
	Screws and nuts which transmit contact pressure: in engagement with a metal thread		N/A
	Threaded part torque test	See appended table 22.1	N/A
22.2	Screws in engagement with a thread of insulating material: correct introduction into the screw hole or nut ensured		N/A
22.3	Contact pressure: not transmitted through insulating material other than ceramic, pure mica or other material no less suitable unless there is sufficient resiliency in metallic parts		C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
22.4	Screws and rivets locked against loosening or turning		N/A
22.5	Current-carrying parts of metal having mechanical strength, electrical conductivity and resistance to corrosion adequate:		N/A
	- copper;		N/A
	- alloy with at least 58 % copper for parts made from cold-rolled sheet or with at least 50 % copper for other parts;		N/A
	- stainless steel with at least 13 % chromium and not more than 0,12 % carbon		N/A
	- steel with electroplated coating of zinc (ISO 2081): service condition ISO no. (1/2/3); IP (X0/X4/X5); thickness (µm) .....		N/A
	- steel with electroplated coating of nickel and chromium (ISO 1456): service condition ISO no. (2/3/4); IP (X0/X4/X5); thickness (µm) .....		N/A
	- steel with electroplated coating of tin (ISO 2093): service condition ISO no. (2/3/4); IP (X0/X4/X5); thickness (µm) .....		N/A
	Current-carrying parts subjected to mechanical wear: not of steel with electroplated coating		N/A
	Metals having a great difference of electrochemical potential: not used in contact with each other		N/A
22.6	Contacts subjected to sliding action: of metal resistant to corrosion		N/A
22.7	Thread-forming screws and thread-cutting screws not used for the connection of current-carrying parts		N/A
	Thread-forming screws and thread-cutting screws used to provide earthing continuity: not necessary to disturb the connection and at least two screws are used for each connection		N/A

23	<b>CREEPAGE DISTANCES, CLEARANCES AND DISTANCES THROUGH SEALING COMPOUND</b>		C
	Values of items 1, 2, 6 and 7 of table 20 applied to terminals for external wiring and not applied to other live parts which are protected by a directly associated fuse with adequate breaking capacity or other current-limiting means, under the provision that the requirements of 101 are fulfilled IEC 60669-2-1		C
	Electronic switches without directly associated fuse or other current-limiting means: comply with table 20		C
23.1	Creepage distances, clearances and distances through sealing compound no less than the values shown in table 20		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Subclause 23.1 not apply to pilot light units. Requirements for pilot light units are given in 13.16		N/A
	Any metal part in contact with a metal part of the mechanism is considered to be a metal part of the mechanism		C
	In double-break switches, the creepage distance mentioned under item 1 in Table 23 or the clearance mentioned under item 6 in Table 23 is the sum of the creepage distance or clearance between one fixed contact and the moving part, and that between the moving part and the other fixe contact		N/A
	The contribution to the creepage distance of any groove less than 1 mm wide is limited to its width		N/A
	Any air-gap less that 1 mm is ignored in computing the total clearance		C
23.2	Insulating compound: not protrude above the edge of the cavity in which it is contained		C
23.101	RCS with control circuit suitable for connection to SELV supply, switching circuit supplied with a voltage greater than SELV, creepage distances and clearances between control and switching circuit not less than 5,5 mm IEC 60669-2-2		N/A
23.102	Wire enamel at least Grade 1 according to IEC 60317, the clearances between the wire of the control coil, live parts of different polarity and the exposed conductive parts reduced to 2/3 of clearances in absence of enamel IEC 60669-2-2		N/A

24	<b>RESISTANCE OF INSULATING MATERIAL TO ABNORMAL HEAT, TO FIRE AND TO TRACKING</b>		C
24.1	Parts of insulating material which might be exposed to thermal stresses due to electric effects and the deterioration of which might impair the safety are not unduly affected by abnormal heat and fire		C
	A current-carrying part or a part of the earthing circuit retained by mechanical means considered to be retained in position. The use of grease or the like is not considered to be mechanical means		N/A
	External conductors cannot be considered as retaining the current-carrying parts		N/A
	Device is examined without conductors while held in position most likely to cause displacement of the current-carrying parts or parts of the earthing circuit with the insulating material in question removed		N/A
	Glow-wire test according to IEC 60695-2-1	See appended table 24.1.1	C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
24.2	Parts of insulating material retaining live parts in position of switches with IP>X0: of material resistant to tracking		N/A
	Tracking test with solution A of IEC 60112	See appended table 24.2	N/A

25	<b>RESISTANCE TO RUSTING</b>		C
	Ferrous parts protected against rusting	Enclosed	C
	Test: 10 min in carbontetrachloride, trichloroethane or equivalent degreasing agent, 10 min 10 % solution of ammonium chloride, 10 min in a box with air saturated with moisture and 10 min at 100 °C ± 5 °C:		N/A
	No signs of rust		N/A

26	<b>EMC REQUIREMENTS</b>		C
26.1	Immunity		■▲C
	Electronic switches be designed so that the switch state (on or off) and / or the setting value protected against interference. The operation of the switch protected against continuous interference ( e.g. IEC 61000-4-3; IEC 61000-4-6; IEC 61000-4-8)	<b>ITC: R-8454</b>	■▲C
	For the following tests, the electronic switch mounted as in normal use in the relevant box, if any, and loaded with all kinds of loads according to the manufacturers specifications, unless otherwise stated in the relevant paragraph of Clause 26		■▲C
	The electronic switch loaded at 100% of the rated load for dimming devices and with a functional load for other electronic switches		■▲C
	The electronic switch tested according to Table 104 with or without operation as specified in the relevant paragraph of Clause 26		■▲C
	If the load connected to the electronic switch controlled by mechanical switching devices and no semiconductor devices present in the load circuit, the test conducted with a resistive load only		■▲C
	For the test without operation, the electronic switch tested in the following states:		■▲C
	a) In the on-state: for electronic switches where the setting can alter the conduction angle is set at ( 100±5)° which result in an output power (rms)		■▲C
	b) In the off-state : For the tests with operation, the electronic switch switched ON/OFF with a minimum operating rate of 1 operation/second. As an alternative, where the setting can alter, the setting value changed e.g from minimum to maximum		■▲C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.



IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	For electronic switches whose cycle of operation limited by their application, the rate of operation during the tests specified by the manufacturer		■▲C
26.1.1	Voltage dips and short interruptions		■▲C
	The electronic switch tested with the test equipment specified in IEC 61000-4-11 as specified in 26.1, in accordance with Table 105, with a sequence of three dips/interruption with intervals of 10 s minimum between each event		■▲C
	The test done on the power supply lines of the electronic switch		■▲C
26.1.2	Surge immunity test for 1,2 / 50 wave impulses		■▲C
	Electronic switches tested for resistance to unidirectional surges caused by overvoltage from switching and lightning transients		■▲C
26.1.3	Electrical fast transient/burst test		■▲C
	Electronic switches tested for resistance to repetitive fast transients/bursts of supply and control terminals/terminations		■▲C
26.1.4	Electrostatic discharge test		■▲C
	Electronic switches mounted as in normal use withstand electrostatic contact and air discharges. The test carried out with resistive load. If the electronic switch not intended to operate incandescent lamps, the test carried out with only one load of the loads specified within the manufacturer's instructions		■▲C
26.1.5	Radiated electromagnetic field test		■▲C
	This test applicable only to electronic switches containing infra-Red (IR) receivers, radio-frequency receivers, passive infra-red (PIR) devices, devices containing microprocessors or similar		■▲C
26.1.6	Radio-frequency voltage test		■▲C
	This test applicable only to electronic switches containing infra-red (IR) receivers, radio-frequency Receivers, passive infra-red (PIR) devices, devices containing microprocessors or similar		■▲C
26.1.7	Power-frequency magnetic field test		■▲C
	This test applicable only to electronic switches containing devices susceptible to magnetic fields, for example, Hall elements, electrodynamic microphones etc		■▲C
26.2	Emission		■▲C
26.2.1	Low-frequency emissions		■▲C
	Electronic switches so designed that they do not cause excessive disturbances in the network		■▲C

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Requirements deemed to be met if the electronic switch complies with IEC 61000-3-2 and IEC 61000-3-3		■▲C
	This requirement applies to each channel of a multichannel dimmer provided that the channels independent from each other		■▲C
26.2.2	Radio-frequency emissions		■▲C
	Electronic switches so designed that they do not cause excessive radio interference		■▲C
	The electronic switch shall comply with the requirements of CISPR 14 or CISPR 15. For electronic switches used for electrical lighting application, CISPR 15 applies		■▲C

101	<b>ABNORMAL CONDITIONS</b>		C
	Electronic switches do not create hazard under abnormal conditions		C

A	<b>ANNEX A (normative)</b>		N/A
	<b>Additional requirements for switches having facilities for the outlet and retention of flexible cables</b>		N/A
3.23	Flexible cable outlet switch: switch having provision for a flexible cable outlet		N/A
7.10	According to the presence of a flexible cable outlet:		N/A
	- without flexible cable outlet		N/A
	- with flexible cable outlet		N/A
10.1	Prevention of access to live parts		N/A
	For flexible cable outlet switches the test is carried out without the flexible cable fitted		N/A
12.2.5	For flexible cable outlet switches the test is repeated with flexible cables of the approved size (see 13.15) following the same procedure		N/A
13.7	Flexible cable outlet switches shall be so designed that an appropriate flexible cable, complying to IEC 60245-4, code designation 60245 IEC 66 or IEC 60227-5, code designation 60227 IC 53, or as specified by the manufacturer, may enter the switch through a suitable hole, groove of gland. The entry shall accept the maximum dimensions of the appropriate flexible cable, having conductors of the cross-sectional area specified in Table A.1 according to the current rating of the switch, but with a minimum of 1,5mm <sup>2</sup> and the entry shall be so shaped as to prevent damage to the flexible cable		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	Cable anchorage for the flexible cable shall be provided such that the conductors are relieved from strain, including twisting, where they are connected to the terminals or termination		N/A
	The cable anchorages shall anchor the flexible cable securely to the switch		N/A
	The design shall ensure that		N/A
	-the cable anchorage cannot be released from the outside		N/A
	-clamping the cable does not require the use of a special purpose tool		N/A
	Screws which are used when clamping the flexible cable shall not serve to fix any other components unless the switch is rendered manifestly incomplete if the component is omitted or is replaced in an incorrect position, or the component intended to be fixed cannot be removed without further use of a tool		N/A

CC	<b>ANNEX CC (normative)</b>		N/A
	<b>Additional requirements for electronic switches using DLT-technology according to IEC 62756-1</b>		N/A
CC.8.1	Telegram type, supported by DLT control units, marked on control device. Complete explanation of telegram type stated in accompanying instruction sheet		N/A
CC.8.2	Extra symbols marked as given		N/A
CC.8.103	Maximum cable length between DLT control device and DLT load given in instruction sheet		N/A
CC.17	Setting adjusted such that highest temperature rise occur		N/A
CC.19.103	Semiconductor switching devices and/or electronic regulating devices subjected to test		N/A
CC.26.2.1	DLT control devices tested at maximum resistive load		N/A

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2				
Clause	Requirement - Test	Result - Remark	Verdict	
12.2.5	<b>TABLE: test with apparatus shown in figure 10 (screw terminals)</b>			N/A
	rated current (A) .....		—	
	type of conductors .....		—	
	smallest/largest cross-sectional area per table 4 (mm <sup>2</sup> ) .....		—	
	number of conductors .....		—	
	nominal diameter of thread (mm); torque per table 5 (Nm) .....		—	
Cross-sectional area (mm <sup>2</sup> )	Diameter of bushing hole per table 6 (mm)	Height H per table 6 (mm)	Mass (kg)	Remarks
supplementary information:				

12.2.6	<b>TABLE: pull test (screw terminals)</b>			C
	rated current (A) .....	25	—	
	smallest/largest cross-sectional area per table 4 (mm <sup>2</sup> ) .....	2,5/ 6,0	—	
	nominal diameter of thread (mm); torque 2/3 per table 5 (Nm) .....	0,8	—	
Cross-sectional area (mm <sup>2</sup> )	Number of conductors	Type of conductors (rigid solid / rigid stranded)	Pull per table 7 applied for 1 min (N)	Remarks
2,5	1	Rigid	50	
6,0	1	Rigid	60	
supplementary information:				

12.2.7	<b>TABLE: tightening test (screw terminals)</b>			N/A
	rated current (A) .....		—	
	nominal diameter of thread (mm); torque 2/3 per table 5 (Nm) .....		—	
Largest cross-sectional area per table 4 (mm <sup>2</sup> )	Permissible number of conductors	Type of conductors (rigid solid / rigid stranded)	Number of wires and nominal diameter of wires per table 8	Remarks
supplementary information:				

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2					
Clause	Requirement - Test		Result - Remark	Verdict	
12.3.10	<b>TABLE: mechanical stresses occurring in normal use</b>			N/A	
	rated current (A) .....	30		—	
	largest/smallest cross-sectional area per table 10 (mm <sup>2</sup> ) .....	4,0/ 10,0		—	
	Number of connection (after that conductor subjected to a pull of 30 N for 1 min) / disconnection	Type of conductor (solid / rigid stranded / flexible)	Cross-sectional area (mm <sup>2</sup> )	Remarks	
	5	Rigid	4,0	Pass	
	5	Rigid	10,0	Pass	
	<b>TABLE: test with apparatus shown in figure 10</b>			C	
	rated current (A) .....	30		—	
	type of conductors .....	rigid solid / rigid stranded		—	
	smallest/largest cross-sectional area per table 8 (mm <sup>2</sup> ) .....	4,0 – 10,0		—	
	number of conductors.....	1		—	
	Cross-sectional area (mm <sup>2</sup> )	Diameter of bushing hole per table 6 (mm)	Height H per table 6 (mm)	Mass (kg)	Remarks
	4,0	9,5	280	280	Pass
	10,0	9,5	280	280	Pass
supplementary information:					

12.3.11	<b>TABLE: electrical and thermal stresses occurring in normal use</b>			C			
Test a)	Test carried out for 1 h connecting rigid solid conductors:			C			
	test current per table 9 (A) .....	30		—			
	nominal cross-sectional area (mm <sup>2</sup> ) .....	10,0		—			
	Screwless terminal number	Voltage drop (mV)		Required voltage drop			
	1	12		≤ 15 mV			
	2	11		≤ 15 mV			
	3	9		≤ 15 mV			
	4	10		≤ 15 mV			
	5	8		≤ 15 mV			
Test b)	Temperature cycles test) carried out on terminals subjected to Test a):			C			
	test current per table 8 (A) .....	30		—			
	nominal cross-sectional area (mm <sup>2</sup> ) .....	10		—			
	allowed voltage drop (mV) .....	≤ 22,5 mV or 2 times 24 <sup>th</sup> cycle value (mV)		—			
	Screwless terminal number	1	2	3	4	5	Remarks

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2						
Clause	Requirement - Test				Result - Remark	Verdict
voltage drop after 24 <sup>th</sup> cycle						
voltage drop after 48 <sup>th</sup> cycle						
voltage drop after 72 <sup>th</sup> cycle						
voltage drop after 96 <sup>th</sup> cycle						
voltage drop after 120 <sup>th</sup> cycle						
voltage drop after 144 <sup>th</sup> cycle						
voltage drop after 168 <sup>th</sup> cycle						
voltage drop after 192 <sup>th</sup> cycle						

12.3.10	<b>TABLE: mechanical stresses occurring in normal use</b>				C
	rated current (A) .....	30		—	
	largest/smallest cross-sectional area per table 8 (mm <sup>2</sup> ) .....	4,0/ 10,0		—	
Number of connection (after that conductor subjected to a pull of 30 N for 1 min) / disconnection	Type of conductor (solid / rigid stranded / flexible)	Cross-sectional area (mm <sup>2</sup> )	Remarks		
2	Rigid	10,0	Pass		
2	Rigid	4,0	Pass		
	<b>TABLE: test with apparatus shown in figure 10</b>				C
	rated current (A) .....	30		—	
	type of conductors .....	<u>rigid solid / rigid stranded</u>		—	
	smallest/largest cross-sectional area per table 7 (mm <sup>2</sup> ) .....	4,0/ 10,0		—	
	number of conductors.....	3		—	
Cross-sectional area (mm <sup>2</sup> )	Diameter of bushing hole per table 4 (mm)	Height H per table 4 (mm)	Mass (kg)	Remarks	
4,0	9,5	280	280	Pass	
10,0	9,5	280	280	Pass	
supplementary information:					

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict

12.3.12	<b>TABLE: deflection test (principle of test apparatus shown in figure 11a)</b>						C	
	Test carried out for 1 h connecting rigid solid conductors:						C	
	test current (A) (equal rated current) .....	30					—	
	required voltage drop (mV) .....	≤ 25 mV					—	
Type of conductor		Smallest			Largest			Remarks
cross-sectional area per table 9 (mm <sup>2</sup> )		4,0			10,0			
force per table 10 (N)		1,0			1,0			
screwless terminal number		1	2	3	1	2	3	
starting point (X = deflection original point)		X	X+10°	X+20°	X	X+10°	X+20°	
voltage drop 1 <sup>st</sup> deflection (mV)		2	2	2	2	2	2	
voltage drop 2 <sup>nd</sup> deflection (mV)		2	3	3	2	2	2	
voltage drop 3 <sup>rd</sup> deflection (mV)		3	3	3	2	2	2	
voltage drop 4 <sup>th</sup> deflection (mV)		3	3	3	2	2	2	
voltage drop 5 <sup>th</sup> deflection (mV)		3	5	5	2	2	3	
voltage drop 6 <sup>th</sup> deflection (mV)		5	5	5	3	3	3	
voltage drop 7 <sup>th</sup> deflection (mV)		5	6	6	3	3	3	
voltage drop 8 <sup>th</sup> deflection (mV)		6	6	6	3	3	3	
voltage drop 9 <sup>th</sup> deflection (mV)		6	6	6	3	3	3	
voltage drop 10 <sup>th</sup> deflection (mV)		6	8	8	3	4	4	
voltage drop 11 <sup>th</sup> deflection (mV)		8	8	8	4	4	4	
voltage drop 12 <sup>th</sup> deflection (mV)		8	9	9	4	4	4	
supplementary information:								

16.1	<b>TABLE: insulation resistance</b>			C
item per table 20	test voltage applied between:	measured (MΩ)	required (MΩ)	
1	500	> 20	5	
supplementary information:				

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
16.2	<b>TABLE: electric strength</b>		C
	rated voltage (V) ..... :	230	—
item per table 20	test voltage applied between:	test voltage (V)	flashover / breakdown (Yes/No)
1	Live Parts and Body	2 000	No
2	Live in and Live Out	2 000	No
supplementary information:			

17	<b>TABLE: temperature rise measurements</b>		C
	cross-sectional area of conductor not less than 1,5 mm <sup>2</sup> (mm <sup>2</sup> ) (table 15) ..... :	4,0	—
	terminal screws: torque (Nm) (2/3 table 3 or appropriate figures 1, 2, 3, 4)..... :	0,8	—
	type of load ..... :	Resistive	—
	rated current (A) / rated load (W or VA) ..... :	30 A	—
	rated voltage (V) ..... :	230	—
	test voltage between 0,9 and 1,1 V <sub>n</sub> (V), whichever is the more unfavourable ..... :	253	—
parts of the electronic switch		max. measured temperature rise (K)	permissible temperature rise (K)
Terminals 1		27	60
Terminals 2		28	60
Varistor		25	60
Capacitor C 21		26	80 (105 – 25)
Transformer		35	85
Capacitor C 20		31	80 (105 – 25)
Battery		29	85
Capacitor C 30		32	80 (105 – 25)
Relay 1		43	85
Relay 2		32	85
Comms CPU		27	85
PCB		21	105
Current Transformer		19	80 (105 – 25)
Enclosure		36	60
supplementary information:			

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.



IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict

19	<b>TABLE: reduced electric strength after normal operation</b>			C
item per table 20	test voltage applied between:	test voltage (V)	flashover / breakdown (Yes/No)	
1	Live Parts and Body	2 000	No	
	<b>TABLE: temperature rise measurements after normal operation</b>			C
	cross-sectional area of conductor not less than 1,5 mm <sup>2</sup> (mm <sup>2</sup> ) (table 15) .....	10,0		—
	terminal screws: torque (Nm) (2/3 table 3 or appropriate figures 1, 2, 3, 4).....	-		—
	type of load .....	Resistive		—
	rated current (A) / rated load (W or VA) .....	30 A		—
	rated voltage (V) .....	230		—
	test voltage between 0,9 and 1,1 V <sub>n</sub> (V), whichever is the more unfavourable .....	253		—
	parts of the electronic switch	max. measured temperature rise (K)	permissible temperature rise (K)	
	Relay	45	70	
supplementary information:				

20.1	<b>TABLE: impact test</b>			C
part of enclosure tested per table 18 (A, B, C, D)	blows per part	height of fall (mm)	Comments	
A	3	100	No Hazard	
supplementary information:				

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
21.2	<b>TABLE: ball pressure test of thermoplastic materials</b>		C
	allowed impression diameter (mm) .....: ≤ 2 mm		—
part under test	material designation / manufacturer	test temperature (°C)	impression diameter (mm)
Terminals	Thermoplastics	125	0,34
supplementary information:			

21.3	<b>TABLE: ball pressure test of thermoplastic materials</b>		N/A
	allowed impression diameter (mm) .....: ≤ 2 mm		—
part under test	material designation / manufacturer	test temperature (°C) <sup>(1)</sup>	Impression diameter (mm)
supplementary information:			
<sup>(1)</sup> 70 °C / 40 °C + highest temperature rise determined during the test of clause 17			

22.1	<b>TABLE: threaded part torque test</b>				N/A
threaded part identification	diameter of thread (mm)	column number (I, II, or III)	applied torque ( Nm )	Times (5/10)	no damage
supplementary information:					

23.1	<b>TABLE: creepage distances, clearances and distances through sealing compound</b>							N/A
	rated voltage (V) .....: —							
item per table 20	creepage distance dcr, clearance cl and distance through sealing compound dtsc at/of:	required cl (mm)	cl (mm)	required dcr (mm)	dcr (mm)	required dtsc (mm)	dtsc (mm)	
		≥		≥		≥		
		≥		≥		≥		
supplementary information:								

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict

24.1.1	<b>TABLE: glow-wire test</b>		C
part under test	material designation / manufacturer	test temperature (°C)	Remarks
Terminals	Thermoplastic	650	Pass
supplementary information:			

24.2	<b>TABLE: resistance to tracking</b>		C
	number of drops .....	50	—
part under test	material designation / manufacturer	test voltage (V)	flashover / breakdown (Yes/No)
pcb		2 000	No
supplementary information:			

101.1.1.1	<b>TABLE: fault conditions test</b>		C
	cross-sectional area of conductor not less than 1,5 mm <sup>2</sup> (mm <sup>2</sup> ) (table 15) .....	10,0	—
	terminal screws: torque (Nm) (2/3 table 3 or appropriate figures 1, 2, 3, 4).....	0,8	—
	type of load .....	Resistive	—
	rated current (A) / rated load (W or VA) .....	30	—
	rated voltage (V) .....	230	—
	test voltage between 0,9 and 1,1 V <sub>n</sub> (V), whichever is the more unfavourable .....	253	—
fault conditions simulated		remarks	verdict
Creepage distance – short circuit			C
<b>TABLE: temperature rise measurements</b>			
	temperature measured after (min) .....		—
parts of the electronic switch		Max. measured temperature rise (K)	Permissible temperature rise (K)
	<b>TABLE: additional temperature rise measurements in case of temperature limited by a fuse</b>		N/A
	current under the relevant fault conditions measured with the fuse short-circuited (A) .....		—
	type of fuse as specified by IEC 60127 .....		—

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
	test duration corresponding to the maximum fusing time corresponding to the current measured (min) .....		—
	parts of the electronic switch	max. measured temperature rise (K)	permissible temperature rise (K)
supplementary information:			
101.1.1.2	<b>TABLE: temperature rise measurements during overload tests</b>		C
	cross-sectional area of conductor not less than 1,5 mm <sup>2</sup> (mm <sup>2</sup> ) (table 15) .....	4,0	—
	terminal screws: torque (Nm) (2/3 table 3 or appropriate figures 1, 2, 3, 4).....	0,8	—
	rated voltage (V) .....	230	—
	test voltage between 0,9 and 1,1 V <sub>n</sub> (V), whichever is the more unfavourable .....	253	—
	parts of the electronic switch	max. measured temperature rise (K)	permissible temperature rise (K)
	Enclosure	53	70
supplementary information:			

102	<b>TABLE: components</b>					C
object/part No.	manufacturer/ trademark	type/model	technical data	compliance to standard	mark(s) of conformity <sup>1)</sup>	
Comm CPU	ESPRESSIE	ESP-WROOM-02U	-	-	CE	
Capacitor C 30	Vishay	VYT	222M Y1 500 V ~ X1 760 V ~	IEC 60384-14	UL; VDE	
Relay 1	HF	NT90RNCS12CB	NC:40 A 240 VAC	-	CQC; UL; TÜV Rheinland	
Relay 2	NHG	JZC-33FCS05DC12V0.45	NC:5 A 240 VAC	-	UL; TÜV Rheinland	
Terminals	Degson	DG260-7.5	300 V 30 A	UL 94	CQC	
Transformer	-	XZM-E22077	230 V ~ 50/ 60 Hz	-	Tested in Sample	
Varistor	AS	S14	K275	-	CSA; UL	

<sup>1)</sup> an asterisk indicates a mark which assures the agreed level of surveillance

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.

IEC 60669-2-2			
Clause	Requirement - Test	Result - Remark	Verdict
102.4.2	<b>TABLE: temperature rise measurements after test for automatic protective devices which only decrease current to the electronic switch</b>		N/A
	cross-sectional area of conductor not less than 1,5 mm <sup>2</sup> (mm <sup>2</sup> ) (table 15) .....		—
	terminal screws: torque (Nm) (2/3 table 3 or appropriate figures 1, 2, 3, 4).....		—
	type of load .....		—
	rated current (A) / rated load (W or VA) .....		—
	rated voltage (V) .....		—
	test voltage between 0,9 and 1,1 V <sub>n</sub> (V), whichever is the more unfavourable .....		—
	parts of the electronic switch	max. measured temperature rise (K)	permissible temperature rise (K)
supplementary information:			

***END OF TEST REPORT***

NOTE: This report relates only to the specific sample(s) tested as identified herein. The test results do not apply to any similar items that has not been tested.





Figure 1



Figure 2



Figure 3

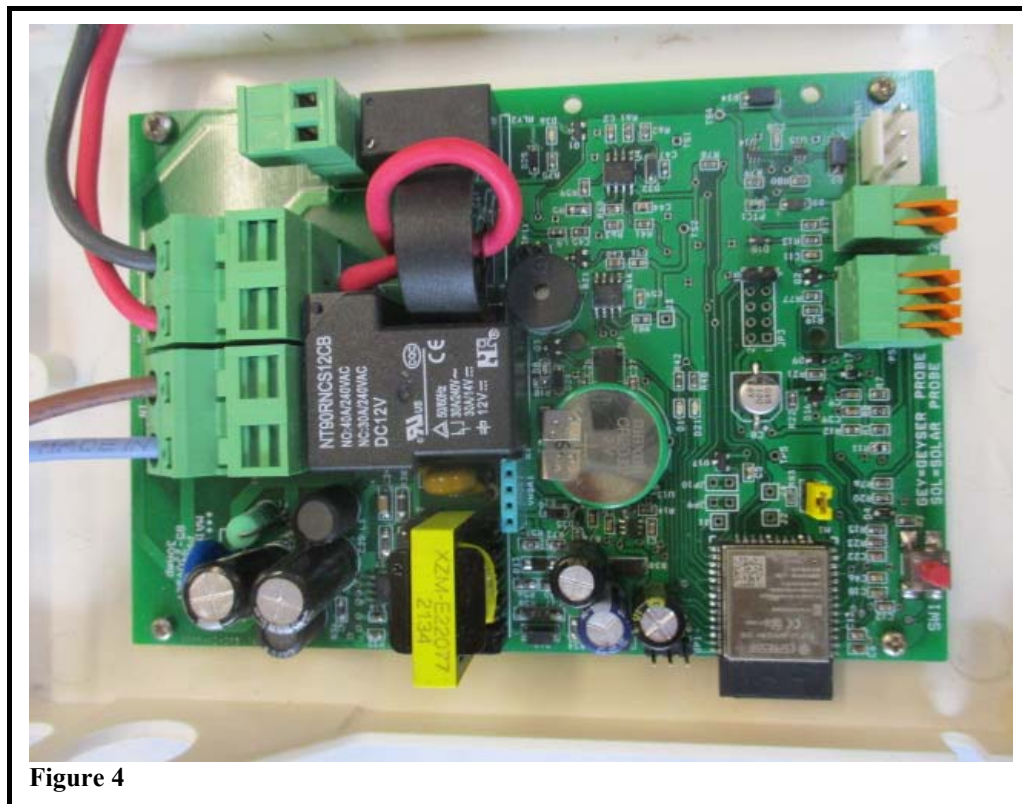


Figure 4



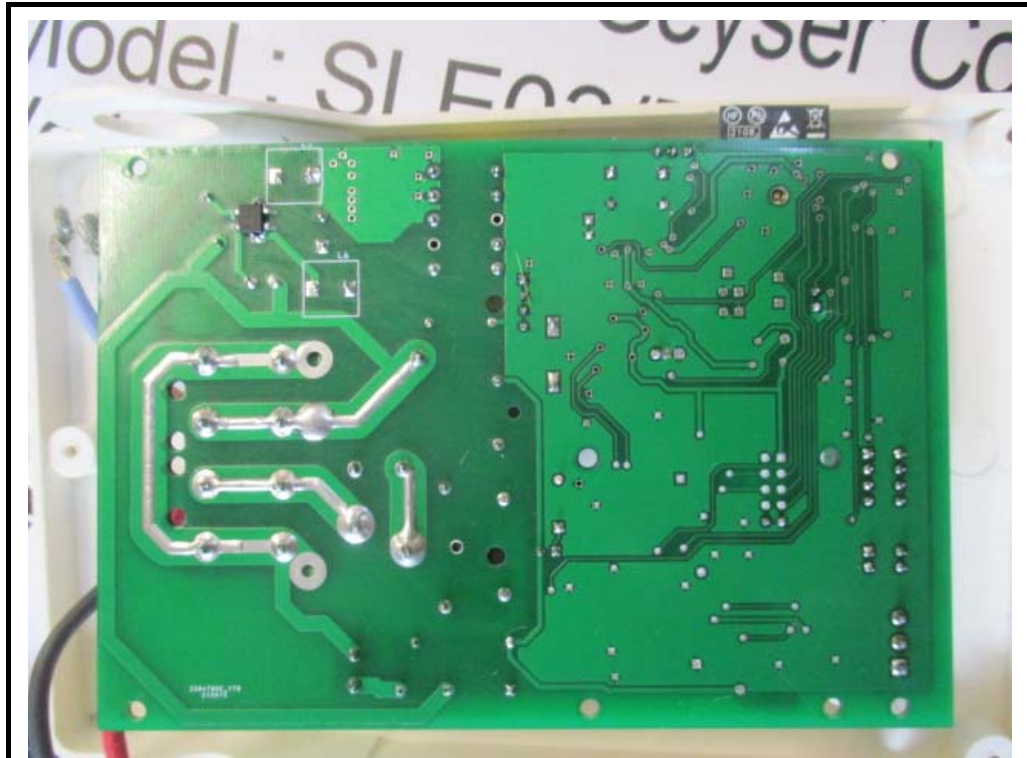


Figure 5

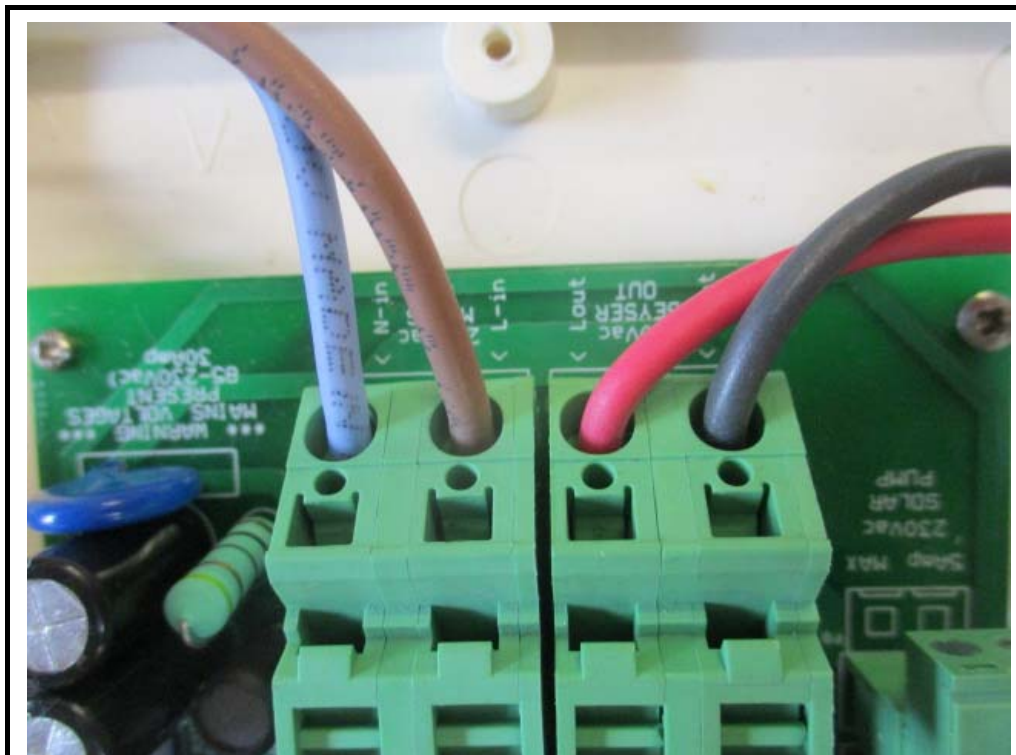


Figure 6



Figure 7